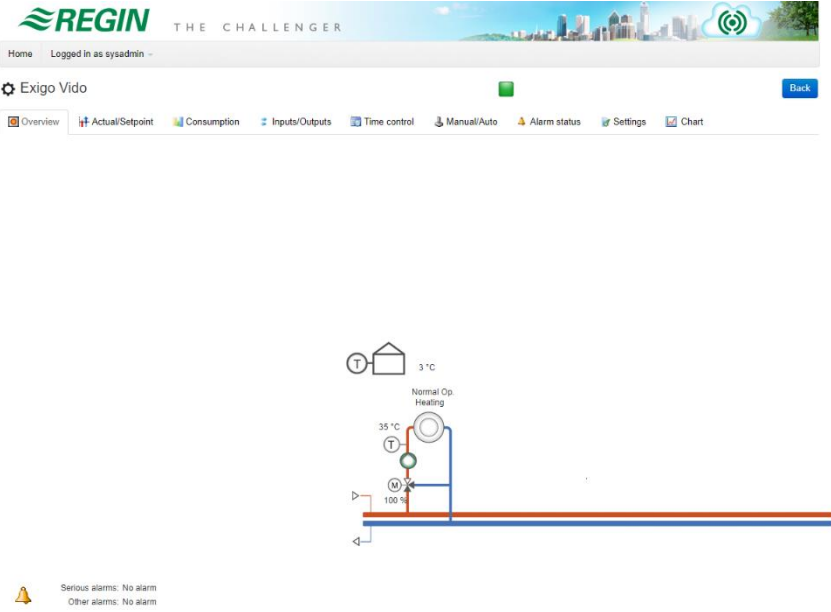
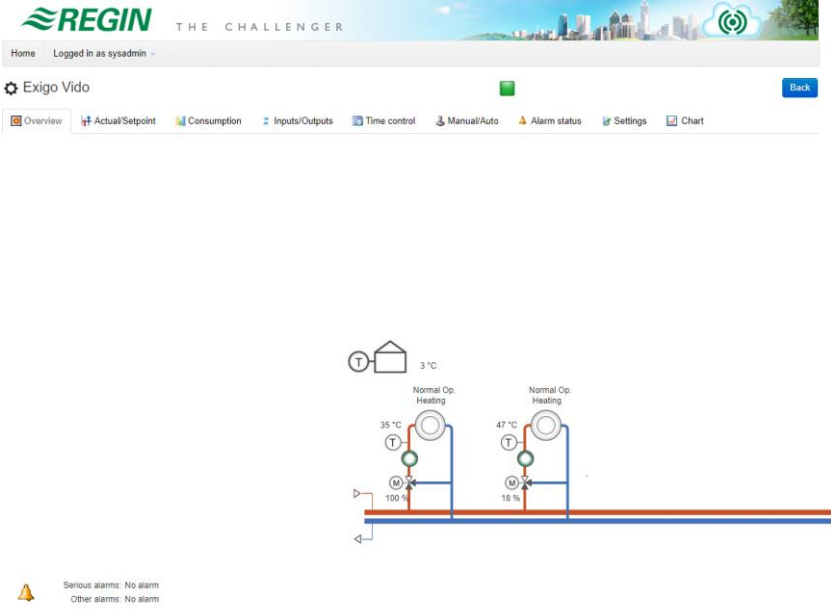
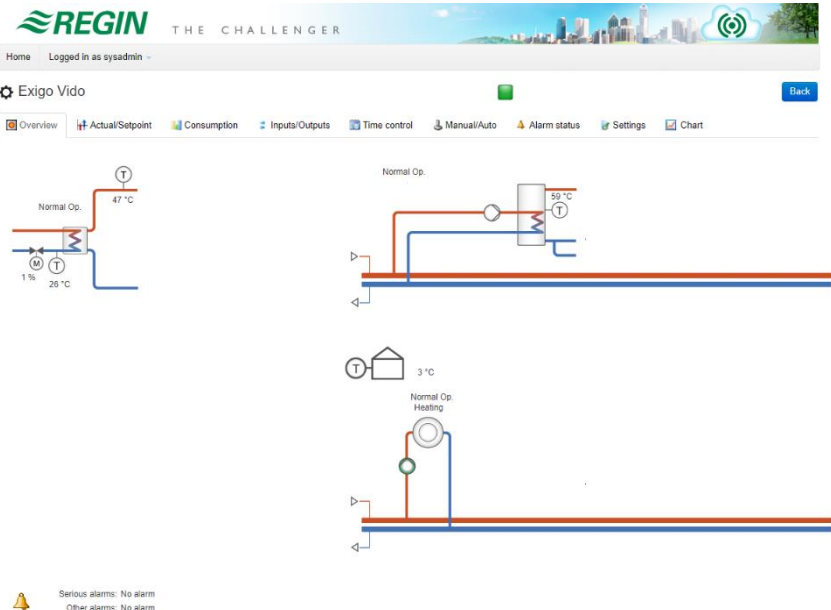



# Pre-defined heating applications Exigo Vido

File name	Description	
HCVxxxxx_00030.htc	mixed Heating system 1 (3-point)	
HCVxxxxx_00033.htc	mixed Heating system 1 (3-point), mixed Heating system 2 (3-point)	
HCVxxxxx_30220.htc	District Heating system (3-point), Hot Water 1 (storage tank + load pump), unmixed Heating system 1	

<p>HCVxxxxx_30230.htc</p>	<p>District Heating system (3-point), Hot Water 1 (storage tank + load pump), mixed Heating system 1 (3-point)</p>	
<p>HCVxxxxx_30232.htc</p>	<p>District Heating system (3-point), Hot Water 1 (storage tank + load pump), mixed Heating system 1 (3-point), unmixed Heating system 2</p>	
<p>HCVxxxxx_30520.htc</p>	<p>District Heating system (3-point), Hot Water 1 (storage tank + PI-load-supply), unmixed Heating system 1</p>	


HCVxxxxxx\_01033.htc

Boiler (1-step + demand), mixed Heating system 1 (3-point), mixed Heating system 2 (3-point)

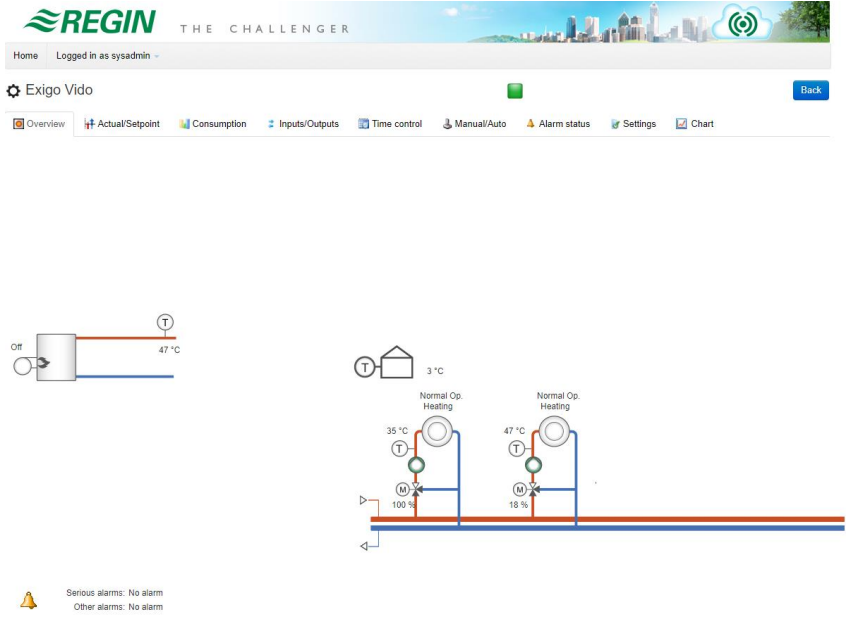


HCVxxxxxx\_01732.htc

Boiler (1-step + demand), Hot Water 1 (storage tank + load pump + solar system), mixed Heating system 1 (3-point), unmixed Heating system 2

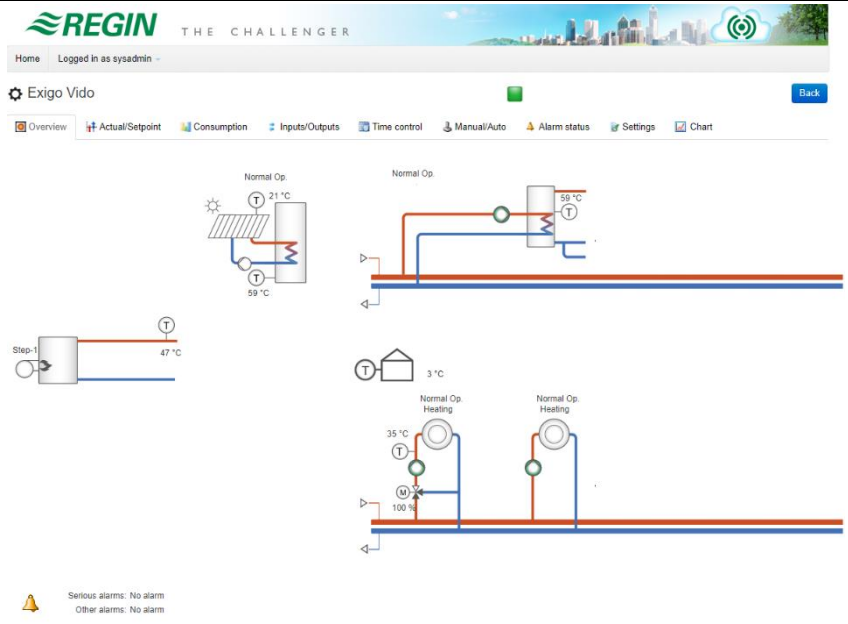

HCVxxxxxx\_02220.htc

Boiler (2-step + demand), Hot Water 1 (storage tank + load pump), unmixed Heating system 1

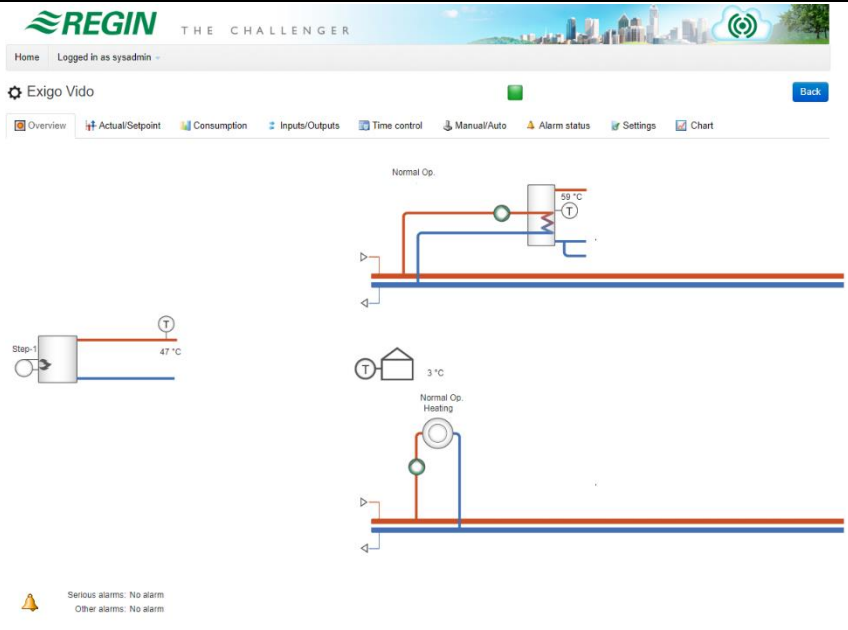

<p>HCVxxxxx_02230.htc</p>	<p>Boiler (2-step + demand), Hot Water 1 (storage tank + load pump), mixed Heating system 1 (3-point)</p>	
<p>HCVxxxxx_02232.htc</p>	<p>Boiler (2-step + demand), Hot Water 1 (storage tank + load pump), mixed Heating system 1 (3-point), unmixed Heating system 2</p>	
<p>HCVxxxxx_02520.htc</p>	<p>Boiler (2-step + demand), Hot Water 1 (storage tank + PI-load-supply), unmixed Heating system 1</p>	

<p>HCVxxxxx_03033.htc</p>	<p>Boiler (1-step + modulation), mixed Heating system 1 (3-point), mixed Heating system 2 (3-point)</p>	
<p>HCVxxxxx_03732.htc</p>	<p>Boiler (1-step + modulation), Hot Water 1 (storage tank + load pump + solar system), mixed Heating system 1 (3-point), unmixed Heating system 2</p>	
<p>HCVxxxxx_03220.htc</p>	<p>Boiler (1-step + modulation), Hot Water 1 (storage tank + load pump), unmixed Heating system 1</p>	

<p>HCVxxxxxx_03230.htc</p>	<p>Boiler (1-step + modulation), Hot Water 1 (storage tank + load pump), mixed Heating system 1 (3-point)</p>	
<p>HCVxxxxxx_03232.htc</p>	<p>Boiler (1-step + modulation), Hot Water 1 (storage tank + load pump), mixed Heating system 1 (3-point), unmixed Heating system 2</p>	
<p>HCVxxxxxx_03520.htc</p>	<p>Boiler (1-step + modulation), Hot Water 1 (storage tank + PI-load-supply), unmixed Heating system 1</p>	